


**Biddle Air Systems Limited**  
St. Mary's Road,  
Nuneaton, Warwickshire CV11 5AU  
Tel: +44 (0) 2476 384233 Fax: +44 (0) 2476 373621



## Isotherm Chassis Fan Coil Unit Operating and Maintenance Instructions

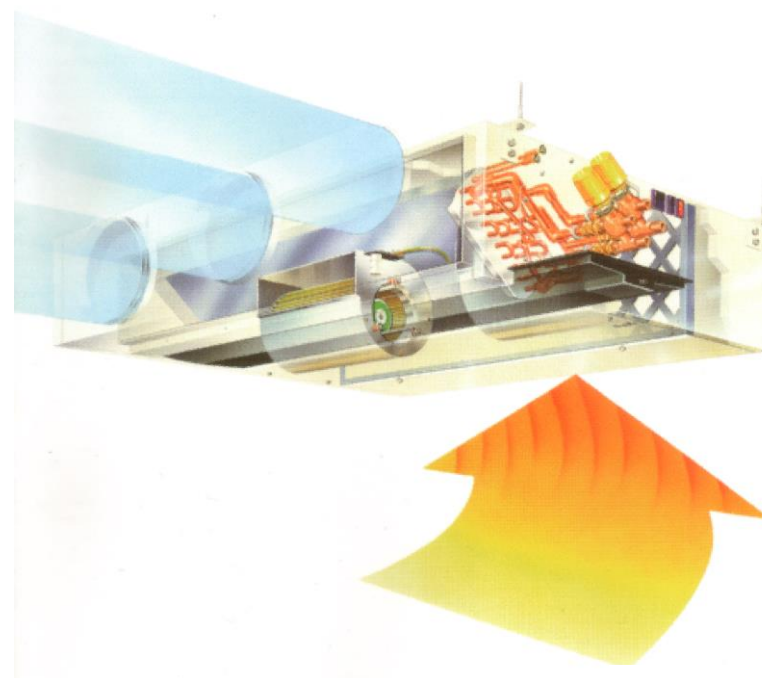


**Isotherm™**  
ADVANCED TECHNOLOGY FAN COILS



**ISO THERM CHASSIS FAN COIL UNITS  
OPERATING AND MAINTENANCE INSTRUCTIONS.**

**CONTENTS:**

H3 GA DRAWING  
UNIT ISOLATION  
ACCESS TO INTERIOR  
FILTERS  
COOLING/HEATING ELEMENT  
FANS  
MOTOR

Page 1	<b>CASING &amp; DRAIN</b>	<b>Page 3</b>
<b>Page 2</b>	WIRING	Page 3
Page 2	ELECTRICAL DATA	Page 4
<b>Page 2</b>	<b>SPARES</b>	<b>Page 4</b>
Page 2	ARTICLE CODES	Page 5
<b>Page 3</b>	<b>V2 &amp; V3 GA DRAWING</b>	<b>Page 6</b>
Page 3		

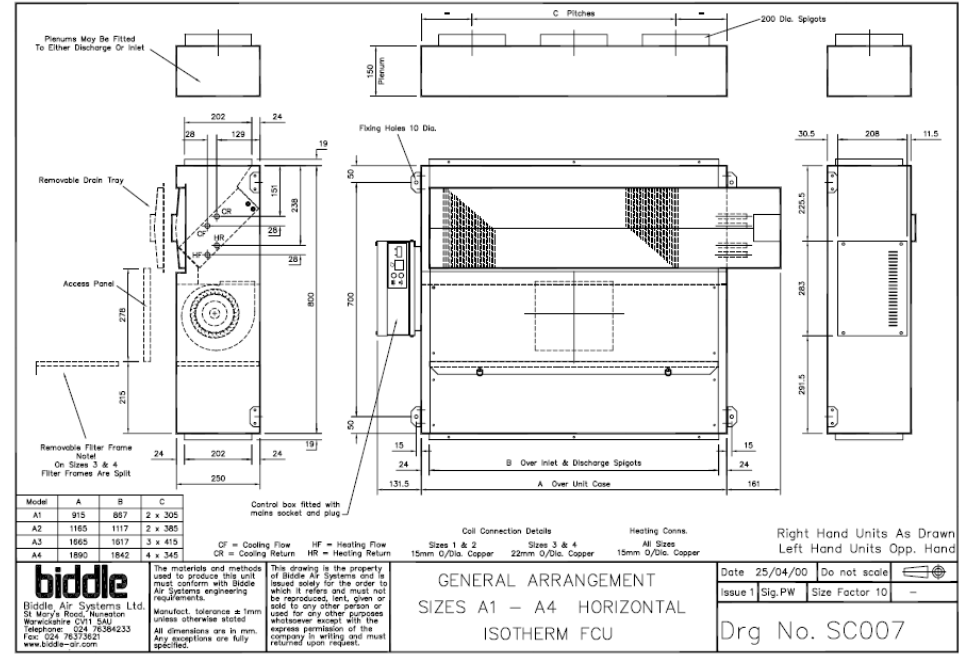

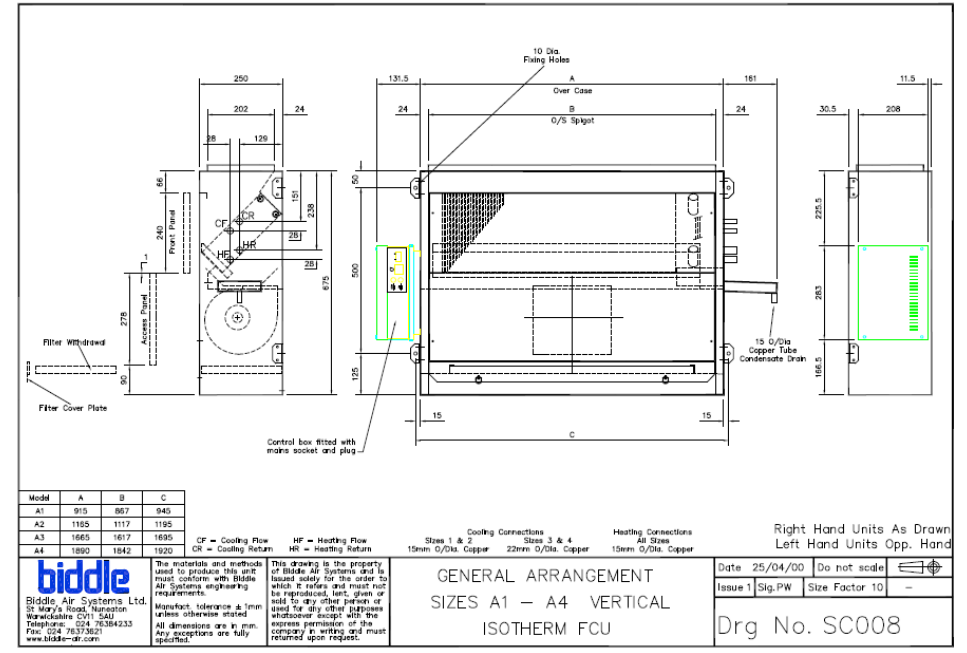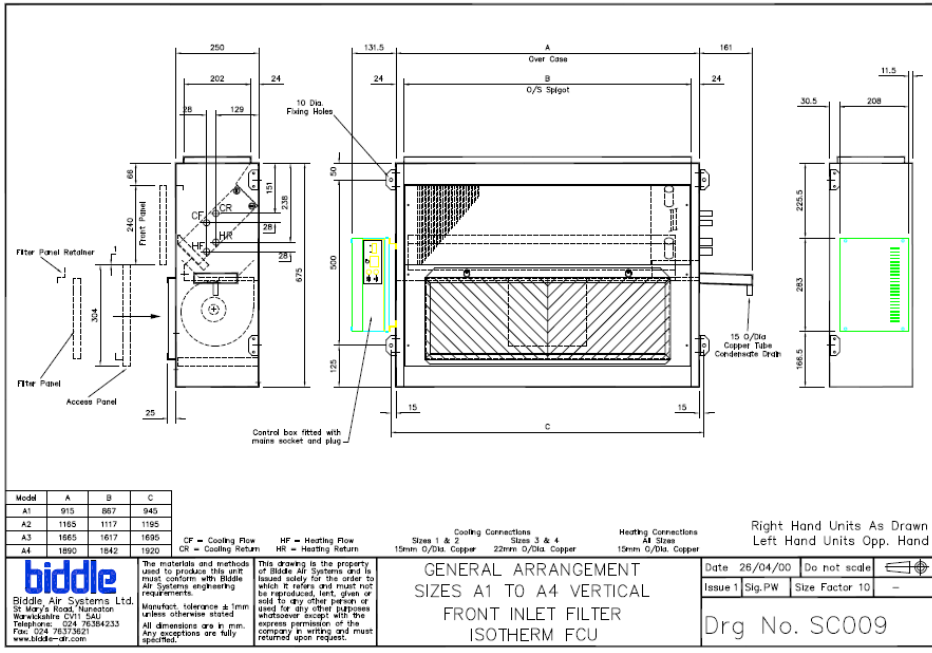

**RECOMMENDED SPARES LIST**  
**ISOTHERM CHASSIS FAN COIL UNIT**

ITEM	MODEL REF	SALES CODE
INDIVIDUAL MOTORS	ALL UNITS	6390500
FILTER ASSEMBLY	ALL UNITS	6590302
ELEMENT (K3/H1)	A1	6390101
	A2	6390102
	A3	6390103

	A4	6390104
ELEMENT (K3/H0)	A1	6390111
	A2	6390112
	A3	6390113
	A4	6390114
ELEMENT (K4/H0)	A1	6390121
	A2	6390122
	A3	6390123
	A4	6390124

---

**IMPORTANT. IT IS ESSENTIAL TO ISOLATE THE UNIT FROM THE ELECTRICAL SUPPLY AND THE CONTROL POWER SUPPLY BEFORE CARRYING OUT ANY MAINTENANCE ON THE UNIT, ALSO TO ENSURE THAT THE POWER CANNOT BE ACCIDENTALLY RESTORED BY UNAUTHORISED PERSONNEL DURING MAINTENANCE.**

When the access panel is removed from the unit, additional safety will be provided by removing the 3 amp fuse from the 3 way fused connector.

Discrete electrical components must always be wired in accordance with the manufacturer's instructions using cable suited to the electrical data given on page 3.

---

### **ACCESS TO INTERIOR.**

The access panel is secured by four "Pozidrive" instrument head screws. This panel gives access to the fans and motor.

---

### **FILTERS.**

These are located before the fans and are accessible via the small access panel, which is secured by quarter turn fasteners. They are accessible without removing the main access panel.

The individual filters are carried in channel slides and can be fully withdrawn by hand. The filter is of non-woven nylon manufacture and should be regularly cleaned from the dirty side with a vacuum cleaner. The filter can be partially cleaned by gentle beating.

The period between cleaning is dependent on operating conditions. In a very dirty atmosphere, the filter will require frequent cleaning.

---

### **COOLING / HEATING ELEMENT.**

Provided the filter is regularly serviced, the cooling/heating element will require little or no attention. However, if the filter is allowed to get very dirty, some dust will percolate through and become entrained in the element. In this case, the element should be cleaned by applying an air jet to the air leaving face.

---

### **FANS.**

These are double inlet, double width centrifugal fans complete with built in direct drive motors. Units comprise of the following number of individual fan/motors.

Model    A1 = One  
             A2 = Two  
             A3 = Three

A4 = Four

Occasionally check the fans for security and, if necessary, carefully clean with a soft brush and a vacuum cleaner.

---

#### **MOTOR.**

These are single phase, direct drive motors with integral thermal protection having pre-lubricated sealed-for-life sleeve bearings requiring no maintenance.

Electric supply 220/240 volt, 1 phase, 50 Hz.

Each motor is controlled via a multi voltage transformer to give three-speed operation.

---

#### **CASING & DRAIN.**

Occasionally clean the interior of the unit, and on cased units check that the paint is in good condition, repaint when necessary.

Always ensure that the condensate drain lines are clear, enabling the condensate to run free from the drain tray. Horizontally mounted units need the casing installed at a slight angle towards the drain connection (5-10mm from the horizontal).

---

#### **WIRING.**

Occasionally check that all terminals are tight and that the cable insulation is in good condition. After servicing, ensure that no parts have been disturbed in such a manner that open terminals (especially spade type) are short-circuited to the unit casing.

---

#### **ELECTRIC DATA.**

Electric supply 220/240, 1 phase, 50 Hz.

The running and locked rotor current will vary according to the operating fan speed of each unit. The following table lists the maximum values for each unit and these should be used for sizing cable, etc.

<b>MODEL No</b>	<b>Absorbed Power (watts)</b>	<b>Locked Rotor Current (amps)</b>
A1	110	0.50
A2	195	1.00
A3	300	1.50
A4	400	2.00

---

#### **SPARES**

When ordering spares from Biddle Air Systems Ltd, please quote the W.O. number, the serial & model number of each unit concerned together with the individual article number for the component required (see chart for article numbers). Details of the unit can be found on the rating plate located inside the unit.

---